


PLAN

NOTES

1. ASSEMBLY SHALL BE MAINTAINED BY OWNER, TESTING IS REQUIRED BY A CERTIFIED BACKFLOW ASSEMBLY TESTER (BAT) AFTER INSTALLATION, THEN ANNUALLY THEREAFTER. A COPY OF TEST REPORT SHALL BE SENT TO THE CITY OF WENATCHEE.
2. WATER MAIN SHALL NOT BE PLACED IN SERVICE UNTIL AFTER REDUCED PRESUURE BACKFLOW ASSEMBLY IS INSPECTED AND APPROVED BY THE CITY OF WENATCHEE.
3. RESTRAIN ASSEMBLY WITH, MEGA-LUGS, RESTRAINED JOINT PIPE OR SHACKLE RODS BACK TO WATER MAIN AS REQUIRED
4. SEE CURRENT ADDITON OF AWWA CROSS CONNECTION CONTROL MANUAL FOR ADDITIONAL DETAILS.

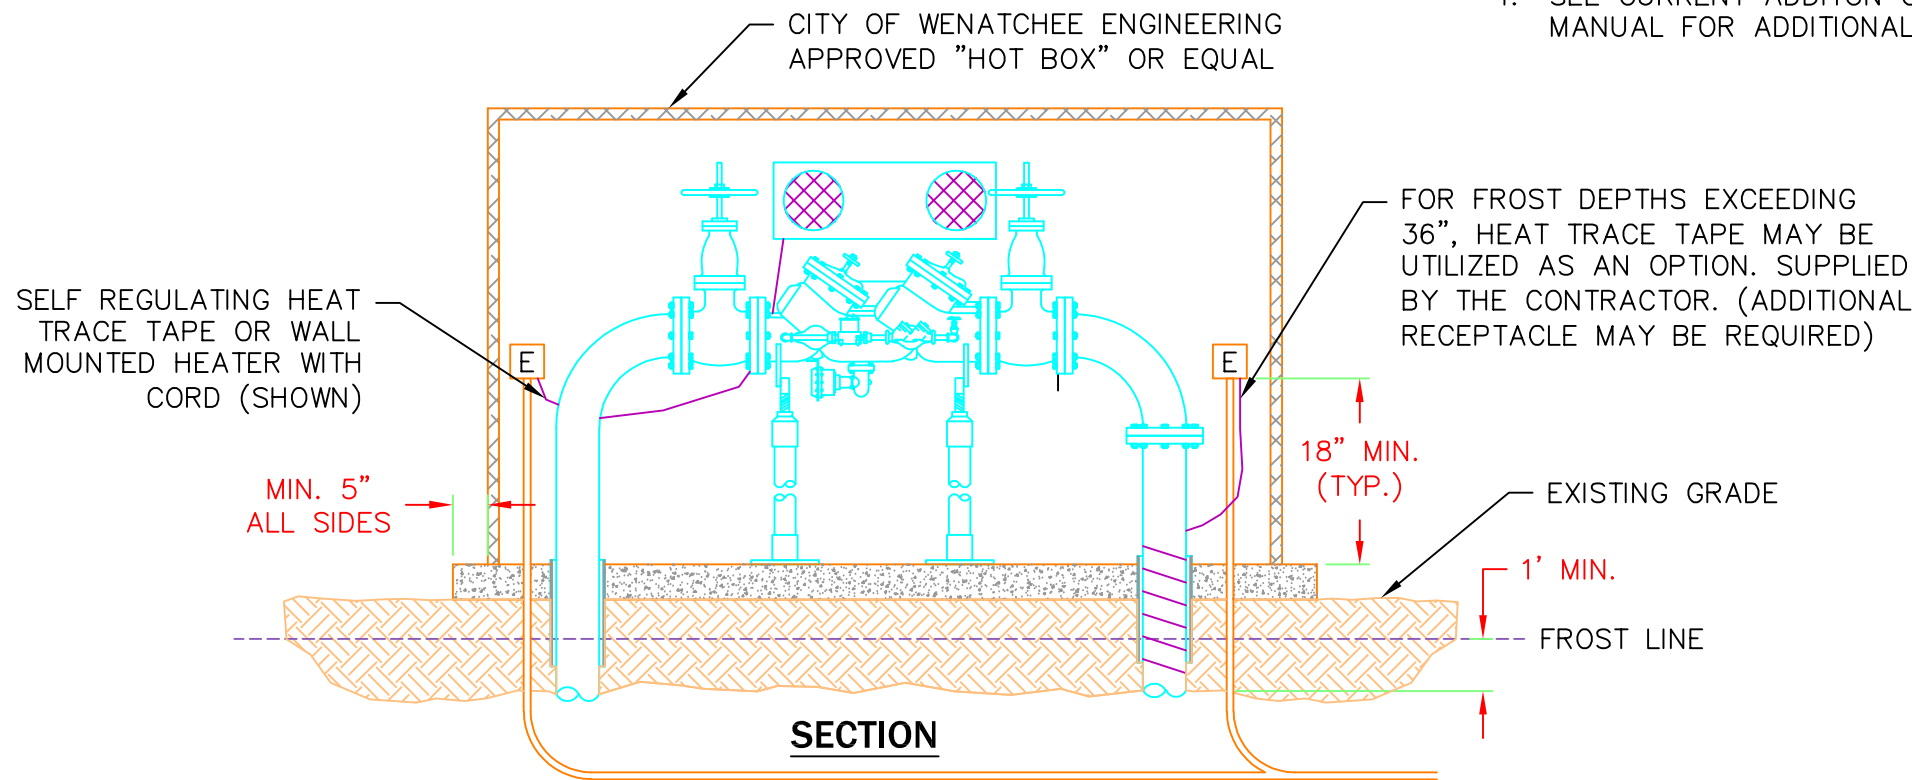

SECTION

**REDUCED PRESSURE
BACKFLOW ASSEMBLIES
RPBA's & RDDA's**

**STANDARD DETAIL
HOT BOX ENCLOSURE
BACK FLOW ASSEMBLY**



REVISIONS	DATE	INITIAL

SCALE: AS SHOWN	DATE DRAWN	CHECKED	DATE APPROVED
DESIGNED BY	DRAWN	APPROVED BY	STANDARD SPECIFICATIONS

DETAIL NO.
W-230
PAGE