


PLAN VIEW

- NOTES:
1. Materials shall be submitted for City approval prior to installation.
 2. Material shall be non-lead, suppliers are typically: Ford, Mueller, and AY McDonald.
 3. Match ball valve size to CTS Poly, minimum pipe diameter is 1 1/2-inch for all single services from water main.
 4. Downstream water service pipe diameter shall be the same as the water meter for ten (10) feet.
 5. Ball valve's compression coupling to the CTS PE water service pipe shall have insert and be a maximum of 2-inches from inside of chamber wall.
 6. ALL TAPS SHALL BE BY CITY CREWS.

ALL CONNECTIONS TO THE DOMESTIC SERVICE MUST BE MADE 3 FEET FROM THE METER CHAMBER. CONTACT CITY OF WENATCHEE WATER DEPARTMENT FOR TURNING OFF/ON WATER INSIDE THE WATER METER CHAMBER. THE CITY OF WENATCHEE STRICTLY PROHIBITS ANYONE FROM ENTERING WATER CHAMBER OR SHUTTING WATER SERVICE OFF WITHIN METER CHAMBER.

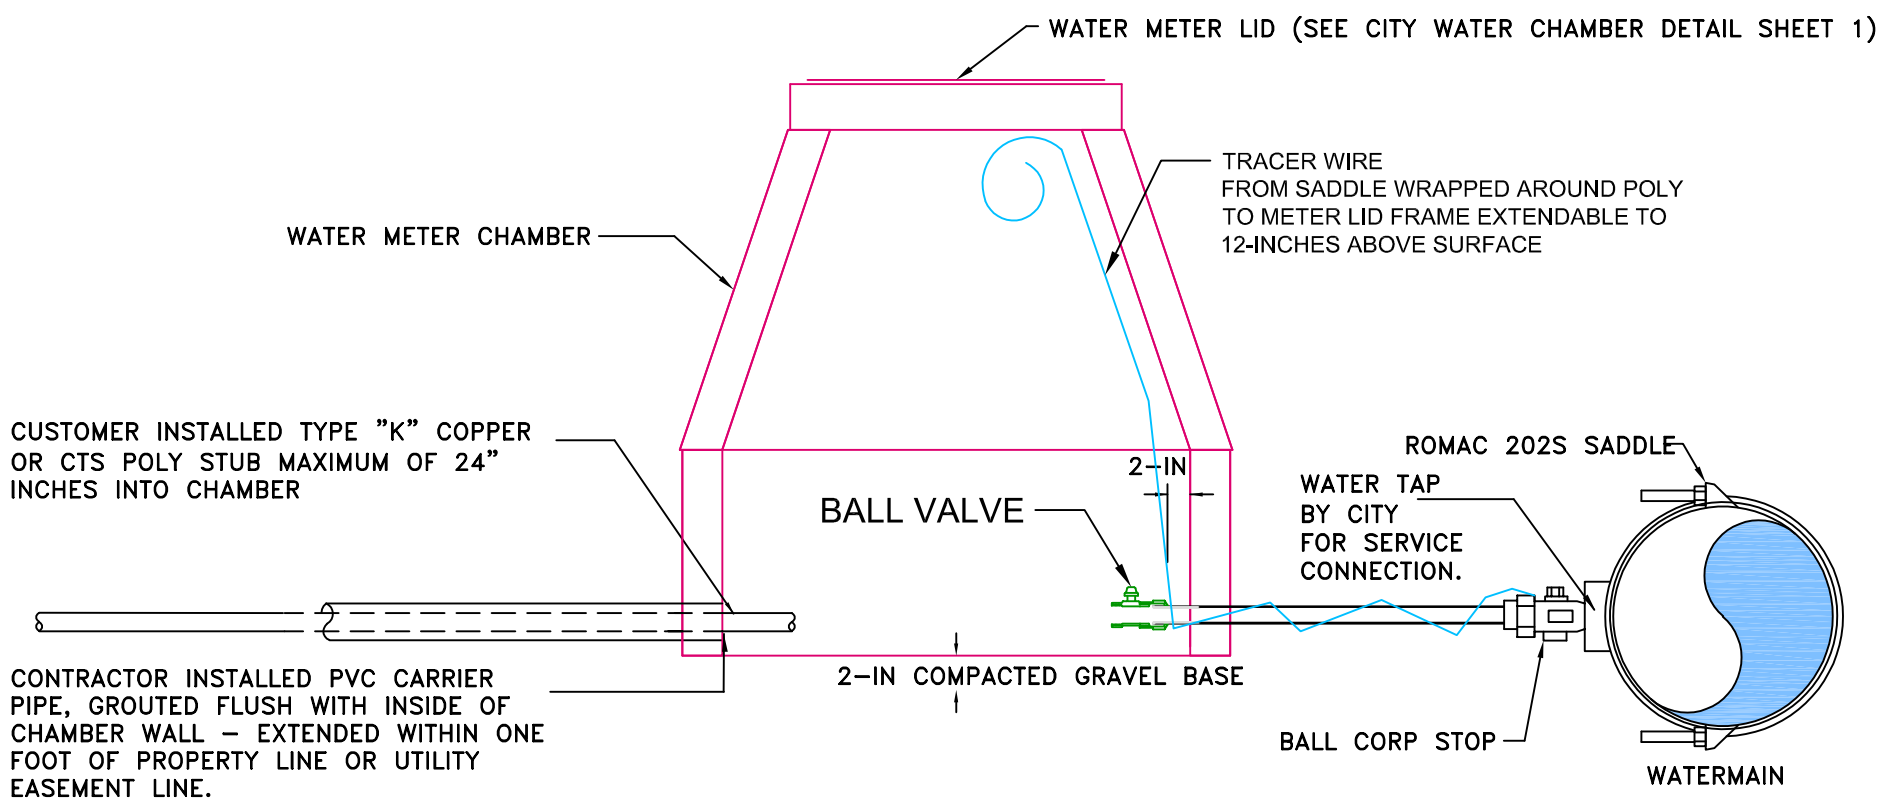

SECTION VIEW

STANDARD DETAIL
1 1/2" OR 2"
SINGLE METER SERVICE



SCALE:	AS SHOWN	DESIGNED BY:	APPROVED BY:	DATE DRAWN:	CHECKED:	DATE APPROVED:	REVISIONS:
	MYW			3/06/2017	DMN		
				04/26/2017	DMN		