


TYPICAL UTILITY PLACEMENT

N.T.S.

NOTES:

1. SANITARY SEWER MANHOLES SHALL BE WSDOT MANHOLE TYPE 1 AND BE CHANNELIZED.
2. STORM SEWER MANHOLES SHALL BE WSDOT MANHOLE TYPE 3 AND BE CHANNELIZED.
3. THROUGH CURB INLET SHALL BE USED WITH ALL CATCH BASINS UNLESS OTHERWISE APPROVED.
4. ALL WATER & SEWER SEPARATION MUST BE DONE IN ACCORDANCE WITH DOE CRITERIA FOR SEWER WORKS DESIGN.
5. ALL CATCH BASINS SHALL HAVE A MINIMUM OF A 21" SUMP.
6. CATCH BASIN OUTLET PIPE TYPICAL 12" DIAMETER.
7. STORM SEWER LATERALS IN ACCORDANCE WITH D-200.
8. SANITARY SEWER LATERALS IN ACCORDANCE WITH S-100
9. STREET LIGHT CONDUITS SHALL BE PLACED ACCORDING TO STREET LIGHTING DETAILS. ALL OTHER UNDERGROUND UTILITIES SHALL BE PLACED BEHIND THE SIDEWALK SO AS NOT TO OBSTRUCT THE PLACEMENT OF FUTURE WATER CHAMBER.
10. THE UTILITY CORRIDOR SHOULD BE PLACED IN THE PLANTER STRIP RESERVING PLACEMENT FOR STREET TREES.

ROAD WIDTH TABLE						
	PRIVATE LANE<500--FEET	RESIDENTIAL LANE	PRIVATE LANE>=500--FEET	LOCAL	COLLECTOR	ARTERIAL
CURB TO CURB (FT)	20	24	27	34	38	44-56

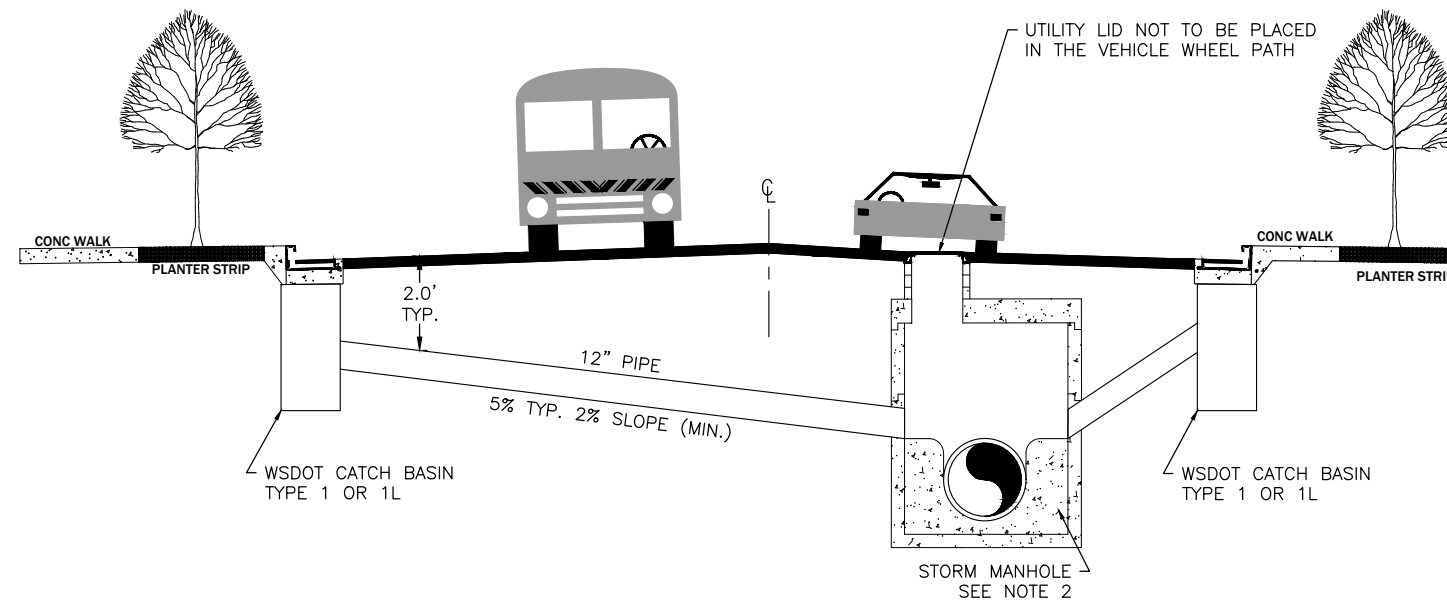

STORM SEWER CONFIGURATION

N.T.S.

**STANDARD DETAIL
UTILITY LOCATIONS
FOR NEW ROADS**



SCALE: AS SHOWN	DESIGNED DMN	DRAWN CAW	APPROVED BY	STANDARD SPECIFICATIONS	REVISIONS			
					DATE	INITIAL	DATE	INITIAL
09/09/2021					01/01/2022	AJS	03/31/2023	JTB

DETAIL NO.
R-350

PAGE
1 OF 1