


SIDEWALK BELOW ROCKERY

ROCKERY HEIGHT (FT)	EMBEDMENT (D)	MIN ROCK SIZE (BASE)	MIN ROCK SIZE (TOP)
2	3 INCHES	2-MAN	1-MAN
4	6 INCHES	3-MAN	2-MAN
6	9 INCHES	4-MAN	2-MAN
7	12 INCHES	5-MAN	2-MAN

NOTES:

1. ROCKERY MUST BE INSTALLED BY LICENSED CONTRACTOR.
2. IF ROCKERY HEIGHT EXCEEDS 4- FEET, IT MUST BE DESIGNED BY A PRACTICING GEOTECHNICAL/CIVIL ENGINEER LICENSED IN THE STATE OF WASHINGTON.
3. FILTER FABRIC SHALL BE MIRAFAI 140 N SERIES OR APPROVED EQUAL.
4. IF ROCKERY IS CLOSER THAN 1V:1H BELOW FACE OF CURB TO BACK OF BASE EMBEDMENT ROCK. IT MUST BE DESIGNED BY AN ENGINEER TO INCLUDE TRAFFIC LOADING OF 250-PSF SURCHARGE.

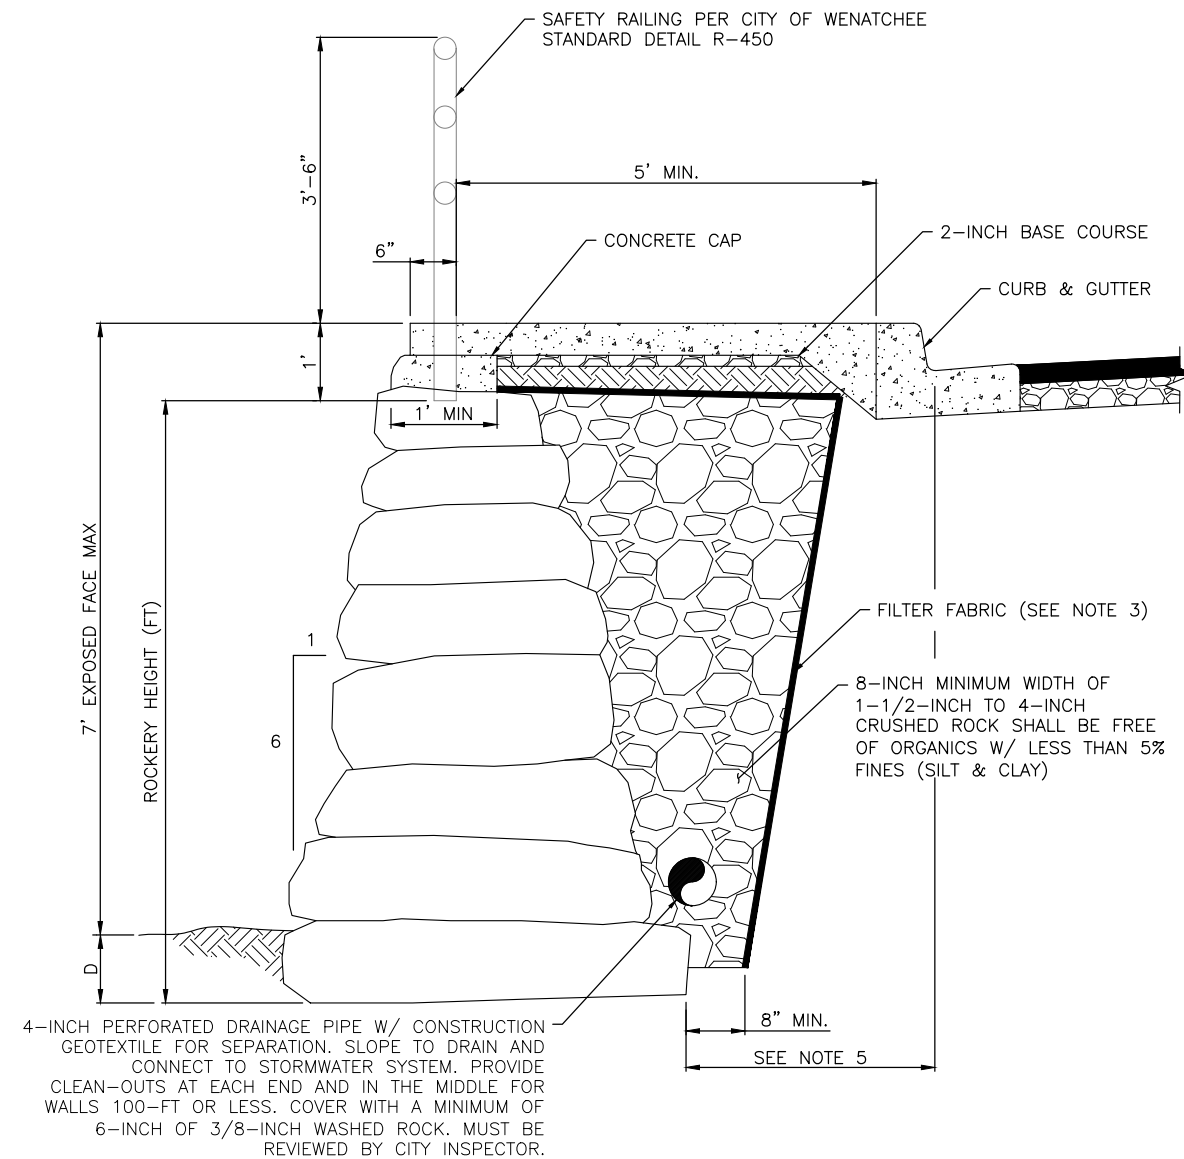

SIDEWALK ABOVE ROCKERY

**STANDARD DETAIL
ROW ROCKERY DETAIL
SIDEWALK SUPPORT**



SCALE: AS SHOWN	DESIGNED	DRAWN	CHECKED	DATE	REVISIONS		
					INITIAL	DATE	DATE
		CAW		10/22/2020			
				01/01/2022	AJS		
				03/31/2023	JTB		

DETAIL NO.
R-410

PAGE
1 OF 1