




**CASE 1 NEW CONNECTION TO EXISTING SEWER MAIN**

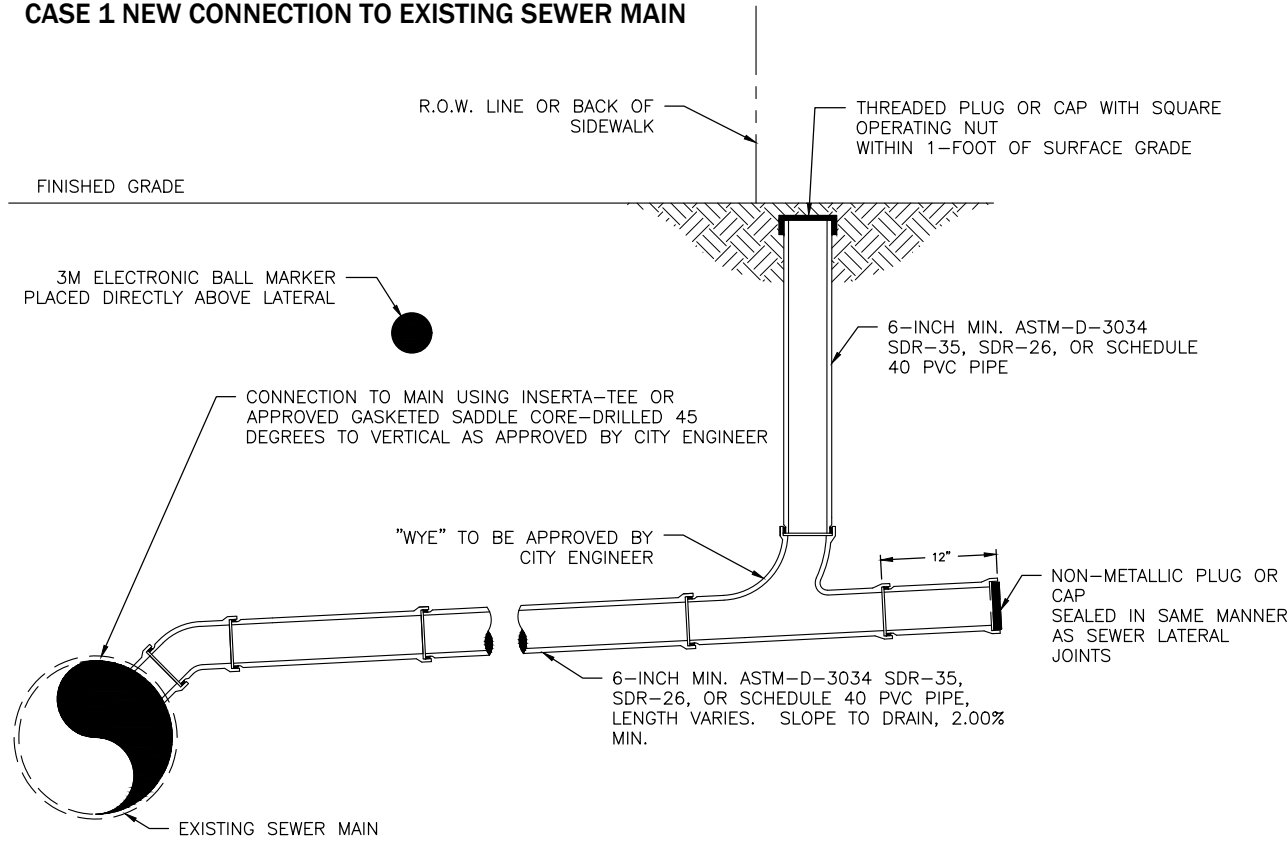

**CASE 2 NEW CONNECTION TO NEW SEWER MAIN**

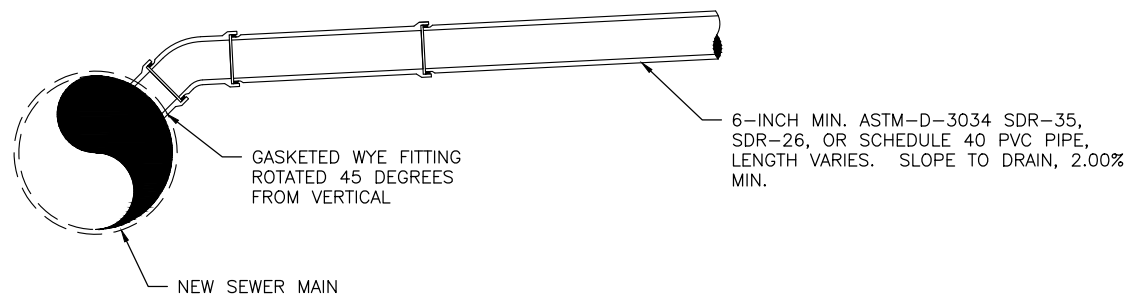

**CASE 3 NEW SHALLOW SEWER CONNECTION**

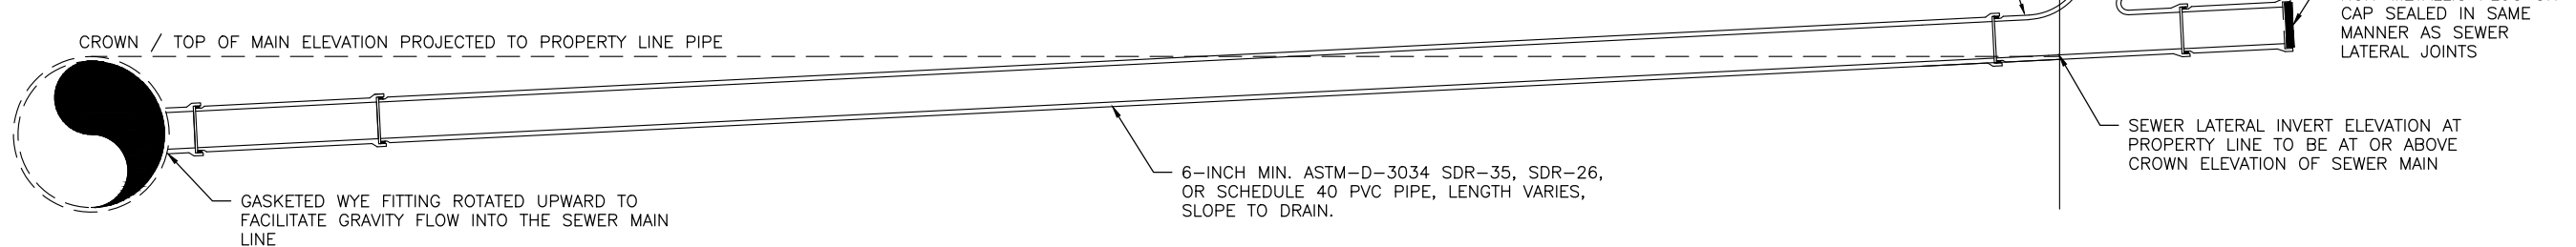

**GENERAL NOTES:**

1. ALL CONNECTIONS MUST BE APPROVED BY THE CITY OF WENATCHEE AND INSTALLED PER MANUFACTURERS RECOMMENDATIONS.
2. LATERAL CONNECTIONS TO THE MAIN LINE SHALL BE A MINIMUM OF 2- FEET APART.
3. LATERAL CONNECTIONS TO THE PUBLIC MAIN LINE SHALL BE DESIGNED TO FLOW BY GRAVITY THROUGH THE POINT OF CONNECTION. PRESSURE SYSTEMS SHALL DISCHARGE INTO GRAVITY FLOW NO LESS THAN 10 FEET UPSTREAM OF THE POINT OF CONNECTION BETWEEN THE 6 INCH LATERAL AND THE MAIN LINE.
4. THE SANITARY SEWER LATERAL, INCLUDING THE TAP, SADDLE, TEE, PIPE, AND CLEANOUT IS CONSIDERED "PRIVATE" UPSTREAM OF THE MAIN LINE POINT OF CONNECTION.
5. MINIMUM 6-INCH DIAMETER CLEANOUTS SHALL BE CONSTRUCTED ON ALL SEWER LATERALS. THE VERTICAL RISER SHALL BE OF EQUAL SIZE AS THE LATERAL PIPE OR LARGER.
6. CLEANOUTS MAY BE LOCATED IN THE PLANTER STRIP AT THE BACK OF WALK, IF ONE EXISTS, AND SHALL BE VISIBLE AT FINISHED GRADE. CLEANOUTS LOCATED BELOW FINISHED GRADE SHALL HAVE ACCESSIBLE COVER.
7. 3M ELECTRONIC BALL MARKER TO BE PLACED 24 TO 36 INCHES BELOW FINISHED GRADE AND SHALL BE GREEN IN PIGMENT.
8. CASE 1: CONNECTIONS TO EXISTING SEWER MAINS SHALL BE CUT USING A HOLE SAW. CONNECTIONS TO EXISTING MAIN LINES SHALL UTILIZE AN APPROVED TAPPING SADDLE OR TEE-WYE CONNECTION. LATERALS SHALL NOT PROTRUDE INTO THE MAIN LINE.
9. CASE 2: CONNECTIONS TO NEWLY CONSTRUCTED MAIN LINES SHALL UTILIZE A MANUFACTURED, GASKETED TEE-WYE INSTALLED IN-LINE WITH THE NEW SEWER MAIN. CORE-DRILLING OF NEW SEWER MAIN LINES FOR SEWER LATERALS SHALL NOT BE PERMITTED.
10. CASE 3: WHERE INSUFFICIENT GRADE EXISTS TO ALLOW SEWERS TO BE INSTALLED IN ACCORDANCE WITH CASE 1 OR 2, FLATTER SEWERS ARE PERMISSIBLE ON A CASE-BY-CASE BASIS AS DETERMINED BY THE CITY ENGINEER. CONNECTIONS SHALL UTILIZE A MANUFACTURED, GASKETED TEE-WYE FITTING INSERTED INTO THE MAIN LINE. CUTTING OR DRILLING BELOW SPRINGLINE IS PROHIBITED. THE INVERT ELEVATION OF THE PRIVATE SEWER LATERAL AT THE PROPERTY LINE IN SUCH INSTANCES SHALL BE AT OR ABOVE THE ELEVATION OF THE CROWN OF THE PUBLIC SEWER MAIN. PRIOR TO SUCH APPROVAL, A SITE-SPECIFIC CONSTRUCTION PLAN AND DETAIL MUST BE PROVIDED TO AND APPROVED BY THE CITY ENGINEER. ANY COSTS ASSOCIATED WITH BYPASS PUMPING WILL BE AT THE CONTRACTOR'S EXPENSE.

**STANDARD DETAIL**  
**SANITARY SIDE SEWER**  
**12 INCH AND SMALLER MAINS**



SCALE: AS SHOWN	DESIGNED BY DMN	DRAWN BY RDH	DATE DRAWN 3/23/2015	REVISIONS							
				DATE	INITIAL	DATE	INITIAL	DATE	INITIAL		
				6/19/2015	DMN	2/9/2016	NJH	01/01/2022	AJS	03/23/2023	JTB

STANDARD SPECIFICATIONS  
 WSDOT 7-08 PIPE INSTALL  
 WSDOT 7-18 SIDE SEWERS  
 SPECIAL PROVISION 7-18.3(5)

DETAIL NO.  
**S-100**

PAGE  
**1 OF 1**