


COMPACTION REQUIREMENTS FOR STORM DRAIN AND SANITARY SEWER STRUCTURES
N.T.S.

NOTES:

1. STRUCTURES INCLUDE STORM DRAIN MANHOLES, CATCH BASINS, AND SANITARY SEWER MANHOLES.
2. REQUIREMENTS APPLY TO VALVE CANS AS SHOWN.
3. CLEARANCE SHALL BE LARGE ENOUGH TO USE A MECHANICAL COMPACTOR.
4. REFER TO CITY DETAIL R-330 FOR UTILITY ADJUSTMENTS.
5. BACKFILL SHALL BE COMPACTED IN A MAXIMUM OF 6-INCH LIFTS.

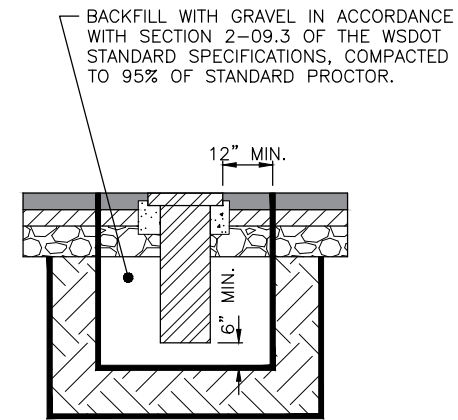

VALVE CAN DETAIL
N.T.S.

**STANDARD DETAIL
STRUCTURE COMPACTION
REQUIREMENTS**



SCALE: AS SHOWN	DATE DRAWN	CHECKED	REVISIONS			
			DATE	INITIAL	BY	DATE
DESIGNED JB	02/21/2006	JB	10/26/2020	CAW		
DRAWN RLK			01/01/2022	AJS		
APPROVED BY			03/31/2023	JTB		
STANDARD SPECIFICATIONS			03/07/2024	JTB		

DETAIL NO.
R-300

PAGE
1 OF 1